



COM-SAN communication interface connection

This document describes the connection of COM-SAN interface option.


1. The standard RS232/RS485 communication interface and communication terminals inside the SanRex PV-xxxK PV Power Conditioner:

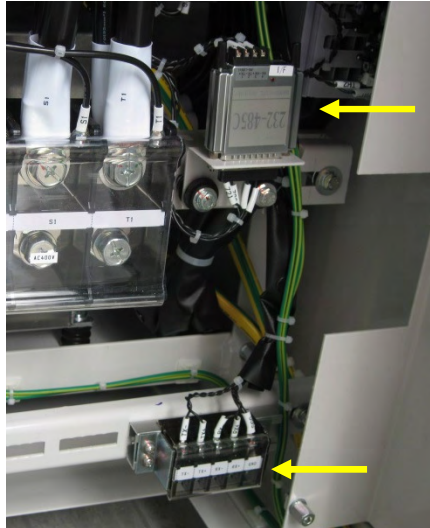

2. The COM-SAN interface option, together with earthing conductor (PE) – length 70 cm.

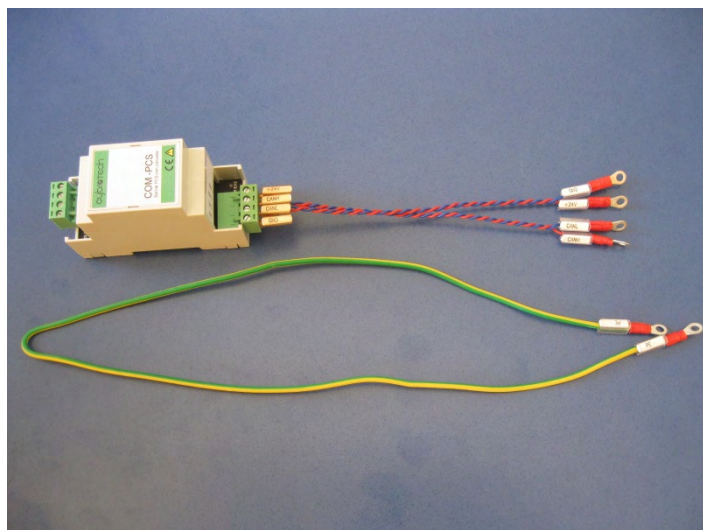



3. Disconnect the standard communication interface with its holder and replace the terminal markings:

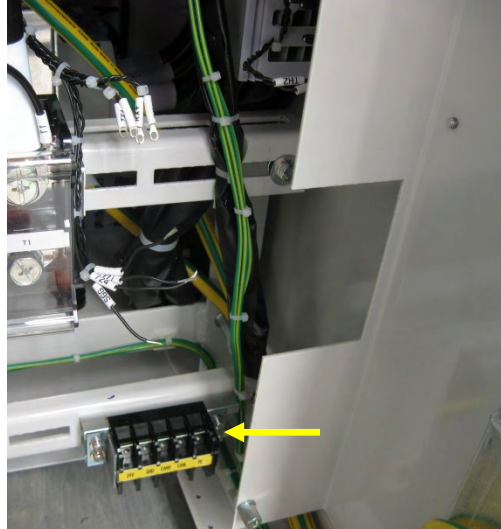


4. Place an additional DIN-rail (length 6 cm) as shown:



5. Connect the COM-SAN and the additional earthing conductor (PE). All the marking numbers on the wires remain the same:

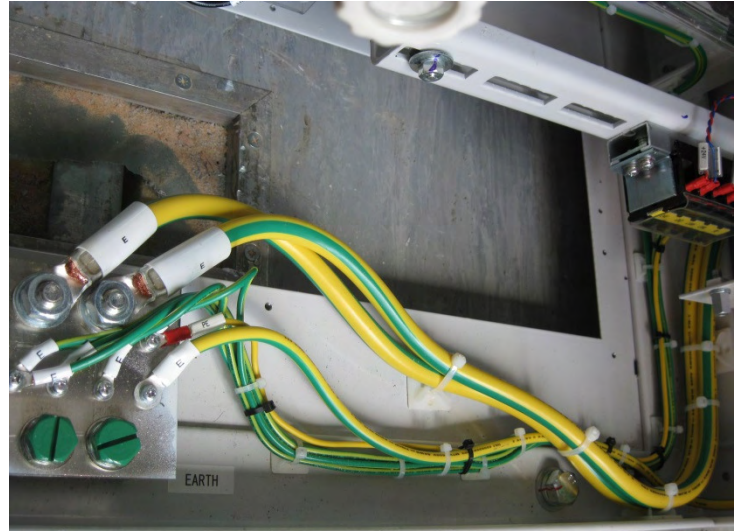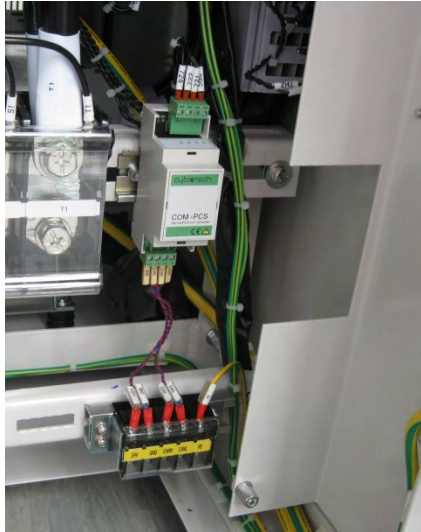

6. Details of connections:

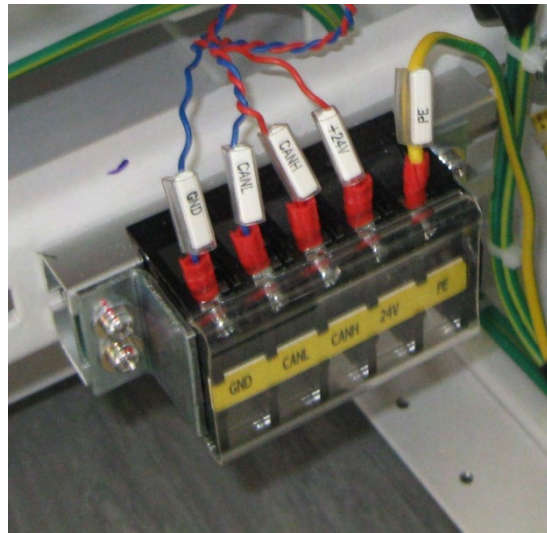

7. Note: the COM-SAN module may be also marked COM-PCS (as shown in the photos), however the functionalities of both interface modules are identical.